



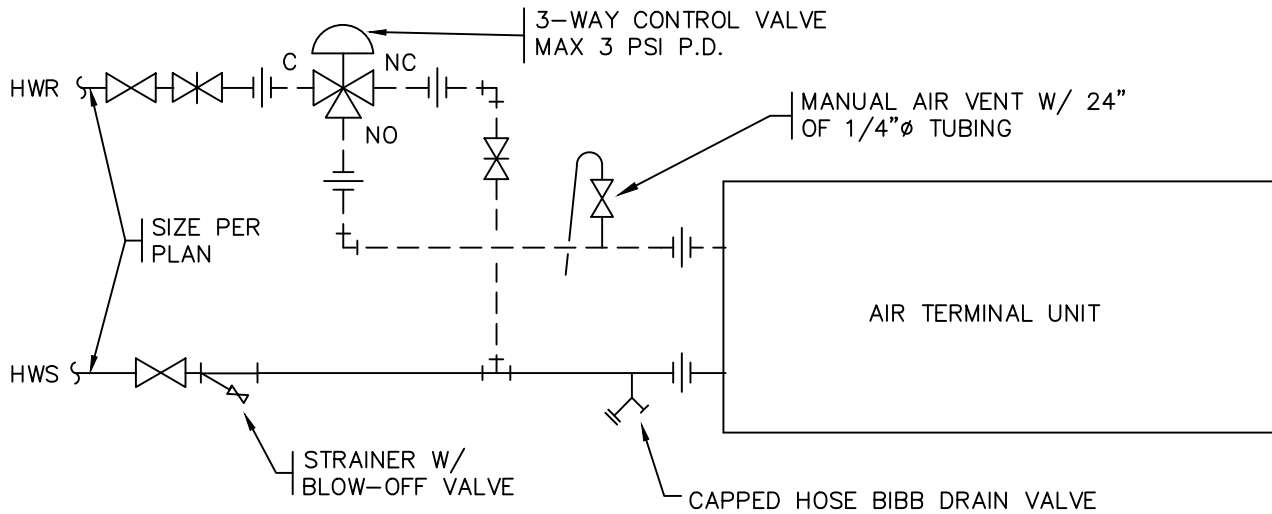

3-WAY CONTROL VALVE

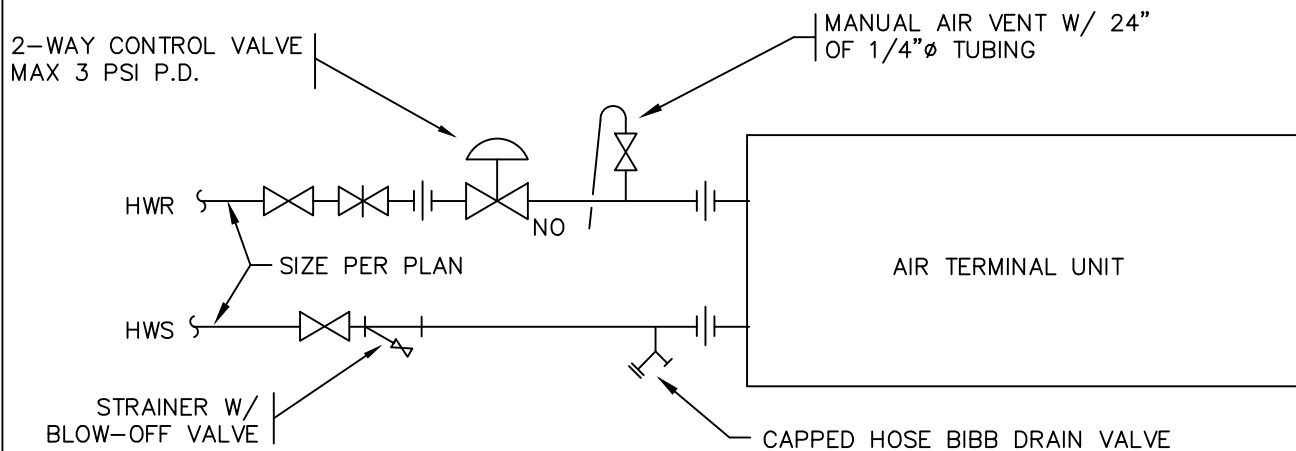

2-WAY CONTROL VALVE

- NOTES:**
1. LOCATE COIL VALVING PIPING SO AS NOT TO OBSTRUCT UNIT ACCESS.
 2. PROVIDE 3-WAY CONTROL VALVE ON VAV-1, 11, 12, & 23.
ALL OTHER UNITS SHALL HAVE 2-WAY CONTROL VALVE.

AIR TERMINAL UNIT COIL

NTS

DESIGNER NOTES:

1. USE 3-WAY CONTROL VALVE AT END OF LINE COILS.



STANDARD DETAILS

DRAWING TITLE:

AIR TERMINAL HEATING COIL DETAIL

DATE: AUGUST, 2000

SCALE: NONE

PLATE NO.: 15569-M1

SPEC. SECT. 15569 PAGE

SYMBOL	REVISION	DATE	APPROVAL