


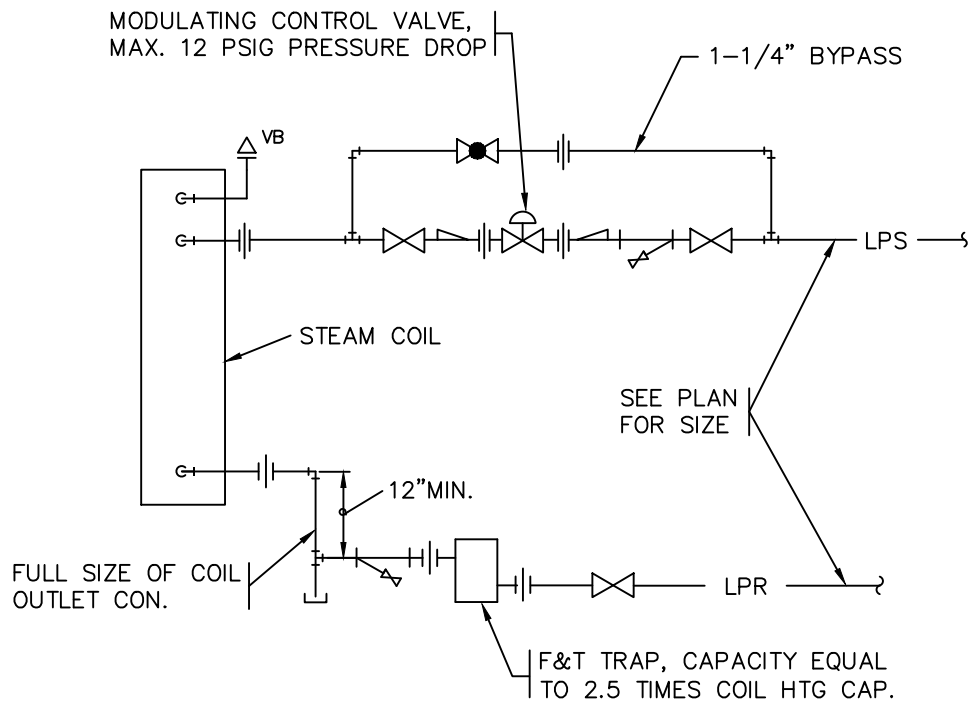

NOTES: 1. LOCATE ALL VALVING & TRAP WITHIN UNIT CABINET

STEAM COIL PIPING PIPING

NTS

DESIGNER NOTES:

1. PROVIDE BY-PASS ONLY WHERE NECESSARY.
2. VERIFY CONTROL VALVE PRESSURE DROP.



STANDARD DETAILS

DRAWING TITLE:

AHU STEAM COIL DETAIL

DATE: AUGUST, 2000

SCALE: NONE

PLATE NO.: 15569-M3

SPEC. SECT. 15569 PAGE

SYMBOL	REVISION	DATE	APPROVAL