


PULL THROUGH VAULT (NO JUNCTIONS)



1. Set vault on firm ground so that top is level (minimum tolerance).
2. All conduits shall be placed so cables naturally coil in the same direction, clockwise being the preferred direction.
3. All conductors to be fire proofed ~~to within 18" of~~ from face of wall to face of wall termination.
4. Conduit entry shall be grouted to prevent silt and other debris from entering the vault.
5. Conduit entry shall be as low as possible on the vault side to provide maximum amount of cover. and room to add future circuits.
6. See Standard AUG-12 for junction box ground.

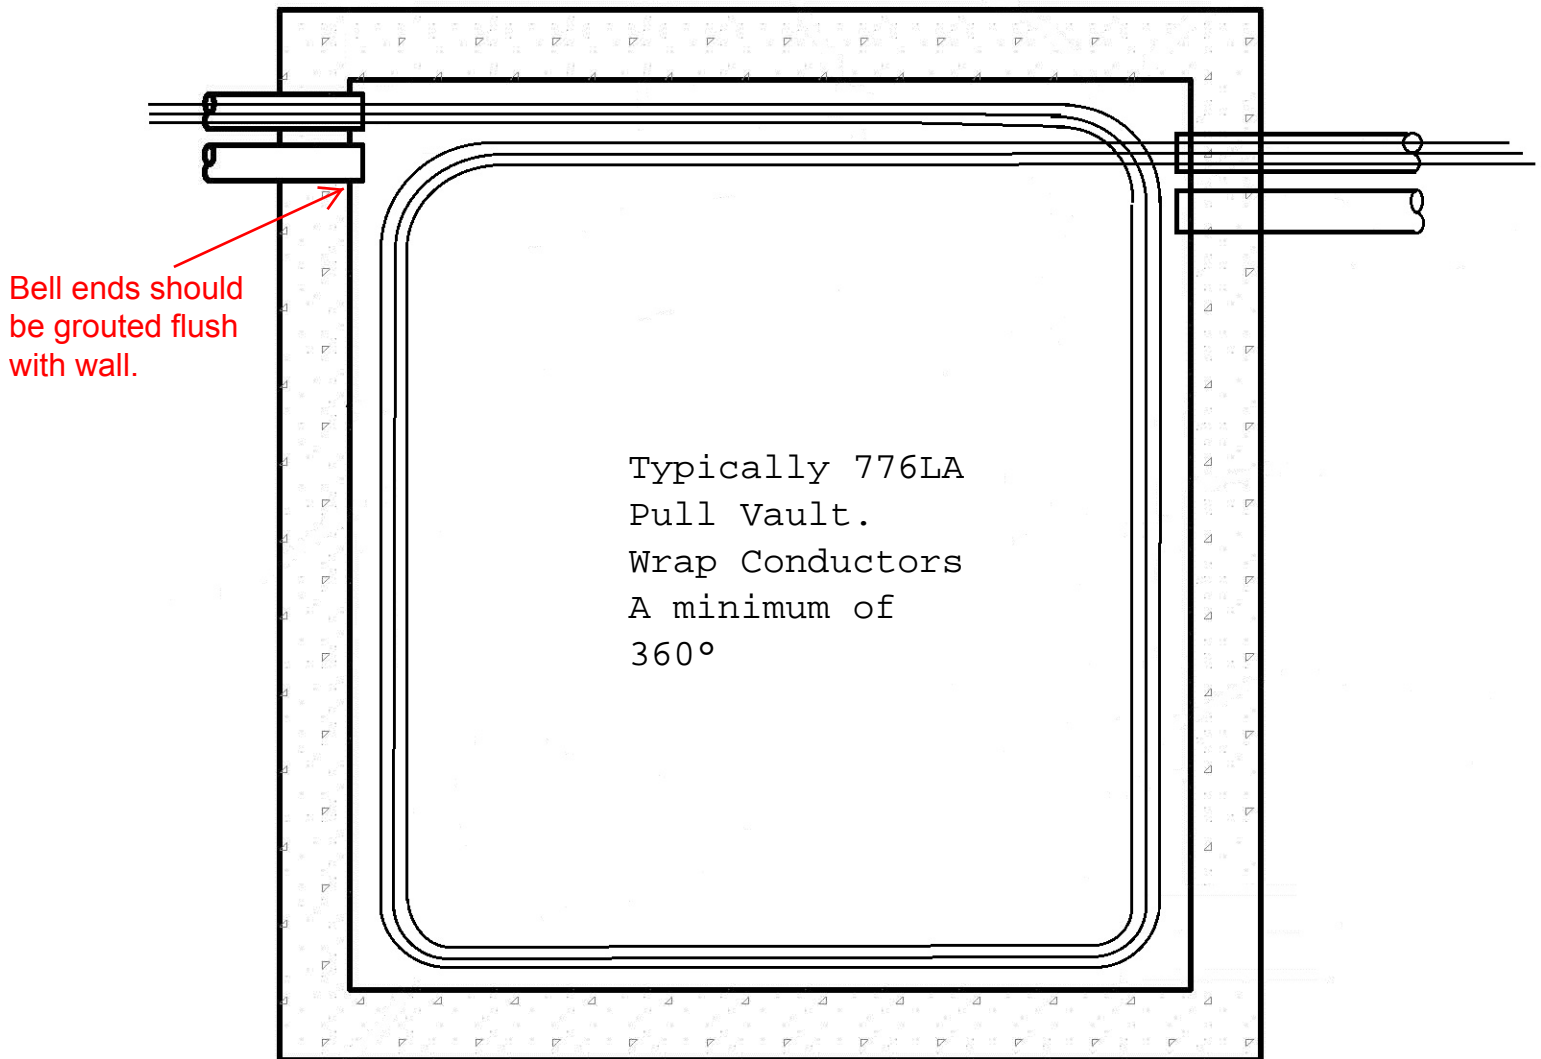

DRAWING TITLE:

UNDERGROUND DISTR PULL THROUGH VAULT

I.J.O. NO.: DEU001324J

SCALE: NONE

SPEC. NO.:

DATE: 4/7/97

FILE NO.:

SHT. NO.:

PLATE NO.:

1 OF 2

SYMBOL REVISION DATE APPROVAL